



Data sheet

Temperature Control Type KPU



KPU temperature controls are temperature controlled electrical switches, which are applied for regulation and safety monitoring of refrigeration and air conditioning systems.

KPU sensors are available with vapor charge or with adsorption charge. Temperature controls with adsorption charge are widely used to give frost protection, while vapor charged sensors are used where small differential is required.

All KPU temperature controls have a single pole double throw (SPDT) contact system. The position of the switch depends on the thermostat setting and the bulb temperature.

Features

- Wide temperature regulating range allows use in low, medium, and high temperature refrigeration application and air-conditioning systems
- Snap-action electrical contacts minimize chatter, bounce and wear, and ensure long-term electrical and mechanical reliability
- Fingertip manual trip feature allows contact function testing without tools
- Easily replaces other manufacturers' temperature controls
- Ultra-short bounce time
- Long operating lifetime
- Vibration and shock resistant
- SPDT switch allows NC or NO function option as well as alarm capability
- Automatic and manual reset versions available

Approvals


UL listed for USA and Canada, file E31024

Technical data

Ambient temperature		-40 – 122 °F, 175 °F up to 2 hours	
Cable entry		7/8 in. cable entry for 1/2 in. male pipe thread connection (conduit boss)	
Maximum wire dimension		10 AWG	
Enclosure		NEMA 1	
Switch		SPDT – single pole double throw	
Contact load	NAM rating	Alternating current	FLA = 24 A at 120 V a.c. 24 A at 240 V a.c.
		Direct current	LRA ¹⁾ = 144 A at 120 V a.c. 144 A at 240 V a.c.
	European rating (acc. to EN 60947)	Alternating current	AC1: 16 A, 400 VA AC3: 16 A, 400 VA
		Direct current	DC13: 12 W, 220 V control current

¹⁾ LRA is rated for make only

Regulating ranges in [°F]

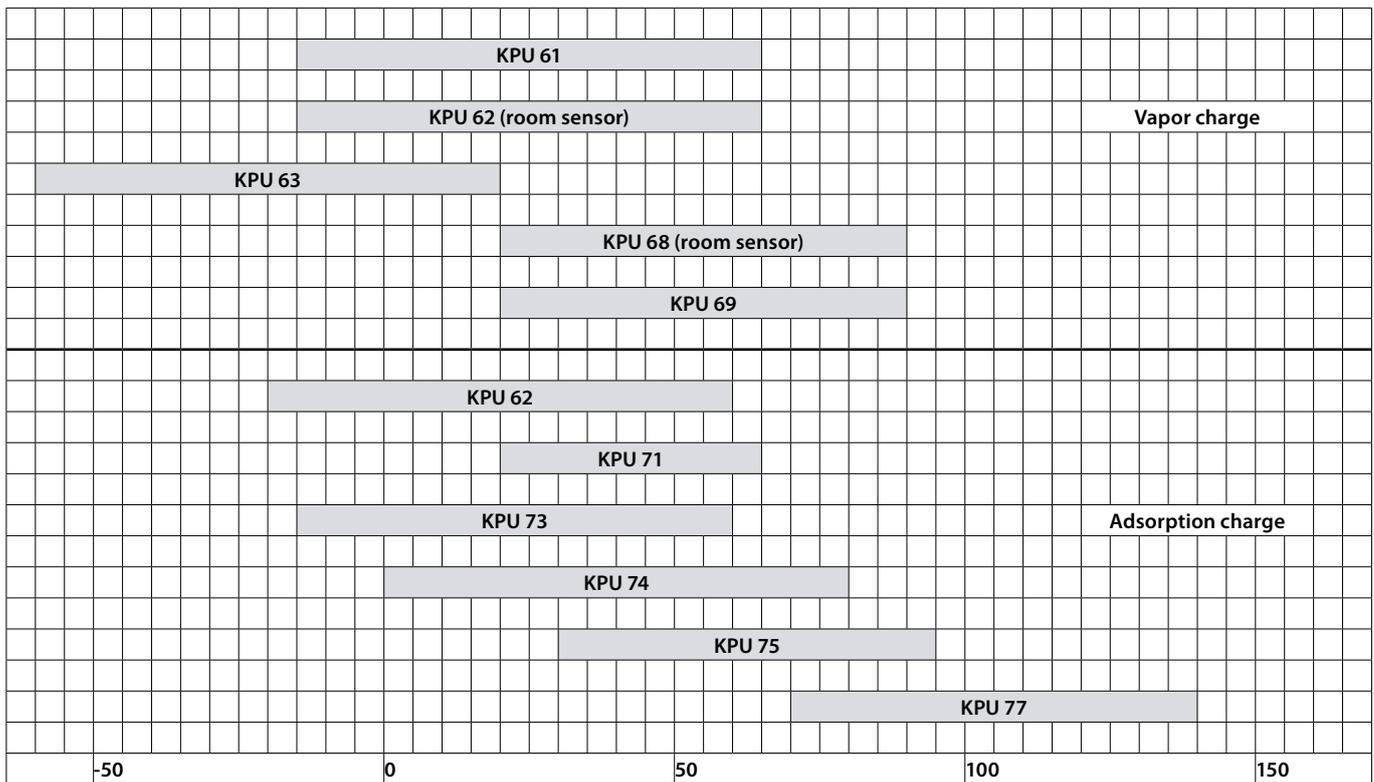

Ordering

Type	Bulb type	Range [°F]	Differential		Max. bulb temp. [°F]	Reset function	Capillary tube length [in.]	Code no.
			at lowest temperature setting [°F]	at highest temperature setting [°F]				
Vapour ¹⁾								
KPU 61	A	-20 – 60	8 – 40	2.5 – 13	250	auto.	80	060L5201
KPU 61	B	-20 – 60	8 – 40	2.5 – 13	250	auto.	80	060L5203
KPU 61B	B	-20 – 60	fixed 10	fixed 3.5	250	man. ³⁾	80	060L5204
KPU 61B	B	-20 – 60	fixed 10	fixed 3.5	250	man. ³⁾	200	060L5205
KPU 62	C1	-20 – 60	8 – 40	2.5 – 13	250	auto.	room sensor	060L5206
KPU 61	B	-20 – 60	8 – 40	2.5 – 13	250	auto. ⁴⁾	80	060L5210
KPU 63	A	-60 – 15	18 – 125	5 – 15	250	auto.	80	060L5213
KPU 63	B	-60 – 15	18 – 125	5 – 15	250	auto.	80	060L5214
KPU 68	C1	25 – 95	8 – 45	3 – 13	250	auto.	room sensor	060L5215
KPU 69	B	25 – 95	8 – 45	3 – 13	250	auto.	80	060L5217
Adsorption ²⁾								
KPU 62	C2	-20 – 60	9 – 36	3 – 14	175	auto. ⁴⁾	room sensor	060L5207
KPU 73	E3	-15 – 60	6 – 18	5 – 50	175	auto.	80	060L5208
KPU 73	E1	-15 – 60	22 – 125	15 – 45	175	auto.	80	060L5209
KPU 73B	E3	-15 – 60	fixed 6	fixed 6	175	man. ³⁾	80	060L5211
KPU 73	D	-15 – 60	6 – 35	5 – 32	175	auto.	80	060L5212
KPU 71	E2	25 – 70	5.5 – 18	4 – 16	175	auto.	80	060L5218
KPU 71B	E2	25 – 70	fixed 5	fixed 5	175	man. ³⁾	80	060L5216
KPU 74	E1	0 – 80	9 – 35	9 – 35	175	auto.	80	060L5219
KPU 74B	E1	0 – 80	fixed 10	fixed 10	175	man. ³⁾	80	060L5220
KPU 75	F	30 – 95	6 – 29	4.5 – 21.5	230	auto.	80	060L5221
KPU 77	E3	60 – 140	6 – 18	6.3 – 18	265	auto.	80	060L5223

¹⁾ Bulb must be installed in colder position than thermostat housing and capillary tube

³⁾ Manual minimum reset. Marked with letter B. Fixed differential. These controls have no hand knob.

²⁾ Bulb can be placed warmer or colder than thermostat housing and capillary tube, but variations from 70 °F ambient temperature will influence the scale accuracy

⁴⁾ With manual switch and top plate

Contact system



Switch type – single pole double throw	Switch action	Application
	1. Terminals 1 – 4 close high and open low Terminals 1 – 2 can be used as low temperature alarm	1. Low temperature cut-out
	2. Terminals 1 – 2 open high and close low Terminals 1 – 4 can be used as high temperature alarm	2. High temperature cut-out

Design / Function

Key sketch of KPU temperature control

KPU temperature control without front cover

1. Temperature setting spindle
2. Differential setting spindle
3. Main spring
4. Differential spring
5. Bellows
6. Capillary tube
7. Main arm
8. Switch
9. Cable entry
11. Temperature sensor
12. Setting knob
13. Differential setting screw
14. Control terminals
15. Ground terminal
16. Contact housing

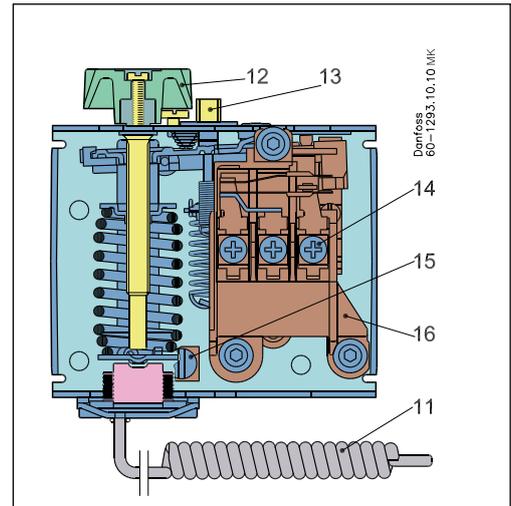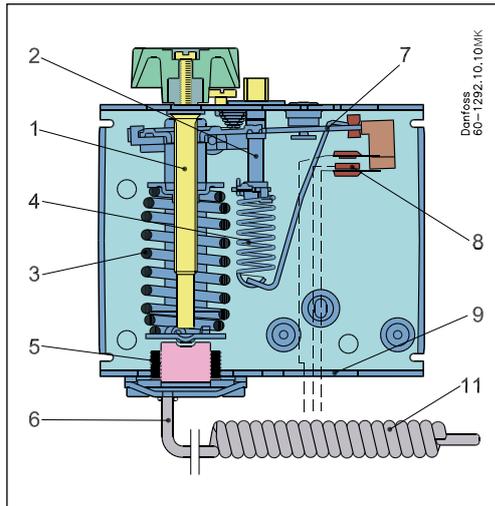

Switches in KPU controls have a snap-action function, triggered when cut-in or cut-out temperature is reached.

Snap-action creates a number of advantages:

- high contact load capability
- ultra-short bounce time
- long mechanical and electrical life
- high resistance to pulsation and vibration
- vibration resistance up to 4 g in range 0 – 1000 Hz
- long mechanical and electrical service life

Terminology

Set point

A predetermined value to which a control is adjusted and at which it performs its intended function.

Differential

The differential is the difference between the cut-in and cut-out temperatures. The differential is necessary for satisfactory automatic operation of the controlled system.

Mechanical differential (intrinsic differential)

The mechanical differential is the differential set by the differential spindle.

Snap function

A specific contact force is maintained until snap is initiated. The time over which contact force reaches zero is a few milliseconds; therefore, contact bounce due to vibration, for example, cannot occur at cut-out. The snap-action contact system will continue to function even when micro-welds are created between the contacts during cut-in. The force created to separate the contacts is strong enough to instantly shear off all contact surface welds that may have been created by cut-in action. These design features ensure that the cut-out setting of the KPU control remains highly accurate and completely independent of the magnitude of the current load.

Reset

1. Manual reset:

A unit with manual reset can only be restored to operational mode by activating the external reset button.

On min. reset units the set value is equal to the cut-out value for falling temperature. On max. reset units the set value is equal to cut-out value for rising temperature.

2. Automatic reset:

A unit with automatic reset is restored to operational mode automatically.

FLA – Motor Full Load Amperes

FLA is the largest current that a motor or other device is designed to carry at rated voltage and other specific conditions. Also often called current at rated conditions.

LRA – Locked Rotor Amperes

LRA is the largest current that the motor is designed to carry with shaft or rotor immobilized.

Setting and resets

Temperature controls with automatic reset

Set the cut-in temperature on the "RANGE" scale. Set the differential on the "DIFF" scale.

The controlled system will start at the temperature set on the RANGE scale and will be stopped when the temperature falls the number of degrees set on the DIFF scale.

Please note that the differential scale is only a reference. The exact value of distances on the scale depends on where in its range the control cut-in is set. Use the differential scale as a guide, and if precise function is required, establish the differential setting by comparing function with an accurate thermometer in the controlled zone. If the compressor does not stop at the desired low temperature, check the differential to ensure that it is not set at too high a value.

The thermostat automatically resets and the compressor starts once the temperature rises above the range scale setting.

Temperature controls with manual minimum reset

Set the cut-out temperature on the range scale. The differential is fixed.

Restart the compressor by pressing the reset button after the temperature of the sensor rises to a value equal to the range scale setting plus the fixed differential.


Temperature controls with manual maximum reset

Set the cut-out temperature on the range scale. The differential is fixed.


Restart the compressor by pressing the reset button after the temperature of the sensor falls to a value equal to the range scale setting minus the fixed differential.

Charges

1. Vapor charge

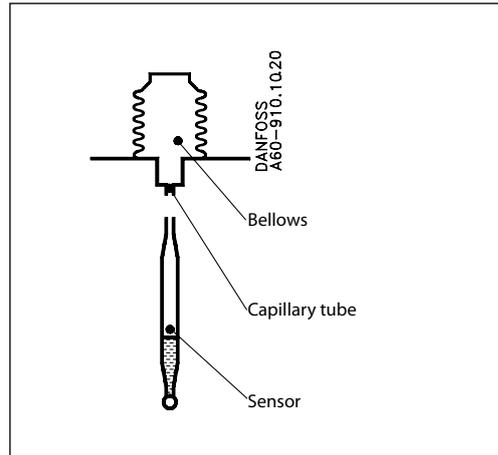


2. Adsorption charge

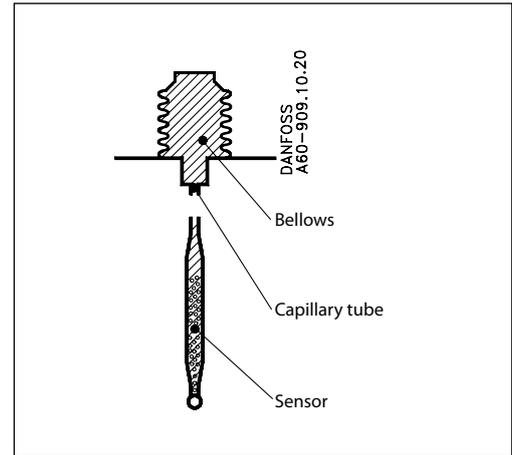

The sensor contains saturated vapor with a small quantity of liquid. When temperature rises, liquid evaporates, and pressure inside the sensor increases. After all of the liquid has evaporated, additional heat results in only a small pressure rise inside the element. Vapor charges are appropriate for low temperature applications and others where the bellows must be protected from deformation by ambient temperature. The sensing element must be colder than the bellows at all times so that condensation of evaporated fluid occurs in the element only, and not in the bellows. As long as the sensor is the coldest part of the thermostat, ambient temperature has no effect on regulating accuracy.

Sensors with adsorption charges contain a superheated gas together with a solid having a large adsorption surface. The sensor can be placed in zones that are warmer or colder than the control housing and capillary tube, but variations of more than 70 °F may influence scale accuracy.

Dimensions of KPU without capillary tube





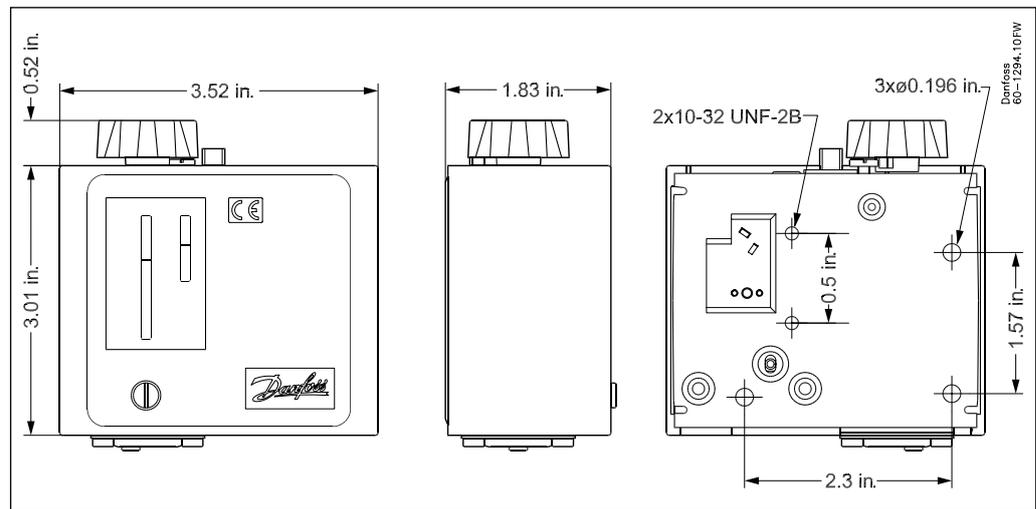


All controls are supplied with universal mounting bracket and mounting screws as standard accessory.

Approximate weight of the bracket and mounting screws: 0.615 lb

- net weight of KPU without capillary tube: ~ 0.77 lb
- net weight of 80 in. capillary tube: ~ 0.17 lb
- net weight of 200 in. capillary tube: ~ 0.43 lb

Temperature controls sensor types

<p>KPU 61 KPU 63 Vapor charge</p>	<p>A</p> 	<p>Straight capillary tube Sensing length: 15 in. a = 3 1/8 in.</p>
<p>KPU 61 KPU 69 Vapor charge</p>	<p>B</p> 	<p>Remote air coil a = 3/8 in. b = 2 3/4 in.</p>
<p>KPU 62 KPU 68 Vapor charge KPU 62 Adsorption charge</p>	<p>C</p> 	<p>Room sensor C1 a = 1 1/2 in. b = 1 1/4 in. Room sensor C2 a = 1 in. b = 3 in.</p>
<p>KPU 73 Adsorption charge</p>	<p>D</p> 	<p>Double contact remote bulb a = 3/8 in. b = 3 3/8 in.</p> <p>NOTE! Can not be used in sensor pocket</p>
<p>KPU 73, KPU 74 Adsorption charge KPU 71, KPU 75 Adsorption charge KPU 73, KPU 77 Adsorption charge</p>	<p>E</p> 	<p>Remote bulb E1 a = 1/4 in. b = 3 3/4 in. E2 a = 3/8 in. b = 4 1/2 in. E3 a = 3/8 in. b = 3 3/8 in.</p>
<p>KPU 75 Adsorption charge</p>	<p>F</p> 	<p>Remote duct coil a = 1 in. b = 3 5/8 in.</p>

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.